

Power Quality Improvement Using FACTS Devices: A Review

Abinash Singh, Balwinder Singh Surjan

Abstract— During the design of modern power systems for efficient operation and continuous power supply to various load centers one has to consider the growth in the use of power electronics that has caused a greater awareness of power quality. Voltage sags, swells, harmonics etc are the various power quality problems that can cause equipment to fail, or shut down, blown up fuses or tripping of breakers due to large current imbalances. FACTS devices can be used to overcome these effects which can otherwise be very harmful for the residential as well as industrial customer, hampering their work production due to faults and equipment damage. This is a review paper to analyze the current trends in FACTS to improve the power system performance. It contains work which has been carried out by various researchers in the field of FACTS.

Keywords— FACTS , STATCOM , DVR, SSC, DSTATCOM, TCSC, IPFC, UPFC.

I. INTRODUCTION

The power quality has become very important for the performance of many industrial applications like production engineering and information technology, and also has an influence on high technology communication devices control and automation, and on-line service. Thus, power quality has obtained increased attention by both industrial as well as commercial electrical users [1]. The power system has to be protected from the surroundings and environment, due to the increased deregulation and overloading of the electricity. As a remedial measure, a power electronics based technology named FACTS has been introduced to control the different parameters of transmission line system [2]. Losses to both the consumers and utilities are a result of poor quality problems. Therefore, the study of power quality problem is becoming a popular research topic. Now a days the consumers are much concerned and aware of various power quality problems and the reasons for this increased concern:

1. The newer-generation load equipments are equipped with microprocessor-based controls and power electronic devices which are very sensitive to power quality variations.
2. With the increased knowledge & awareness regarding various power quality problems and their effects have arisen the customers to challenge the utilities to improve the quality of power delivered.

3. The failure of any component has more important consequences to the whole system due to the advanced trend of the interconnected network with integrated processes. Basically power quality is the quality of the received voltage in most cases. Therefore, to maintain the supply voltage within certain limits is main criteria of utilities.

4. Over the last few years the usage of computers has increased considerably in office and homes due to modern lifestyle and for fast work output so the users have become more sensitive to interruptions while depending on this technology. It should be the prime objective of end user to overcome the inadequacies in power equipment while buying and operating it [3].

Power quality does not only depend on the suppliers but it also depend upon the user that how they consume electricity. Power quality at the generator can be defined as the generator's ability to generate power at 50 Hz with little variation, while power quality at the transmission and distribution level refers to the voltage staying within plus or minus 5 percent. Gerry Heydt in 'Electric Power Quality' defines power quality as - the measure, analysis, and improvement of bus voltage, usually a load bus voltage, to maintain that voltage to be sinusoidal at rated voltage and frequency [4]. With the advancement of technology a large numbers of sophisticated electrical and electronic equipment, such as computers, programmable logic controllers, variable speed drives etc. there is reduction in power quality and this leads to loss in terms of time and money of the industrial and commercial electrical consumers [5].

Implementation of various FACTS devices in the power system can help in reducing the various power quality problems. For the efficient use of power system resources a concept of Flexible AC Transmission Systems (FACTS) was introduced in the late 1980's. The basic concept of FACTS devices is based upon the use of high-voltage power electronics to control real and reactive power flow and voltage in the transmission system [6]-[8].

The paper is organized as follows: Section II provides a brief description of the various power quality problems. Section III presents various FACTS devices and their role in achieving Power Quality, by mentioning the work done in this area. Lastly, conclusions are drawn in Section IV.

II. POWER QUALITY PROBLEMS

A. Various Power Quality Problems are as follows:

- a) **Impulse** : Narrow pulse with fast rise and exponential or damped oscillatory decay; 50 V to 6 kV amplitude, 0.5 μ s to 2 ms duration can be defined as impulse as shown in Fig. 1(a). Its causes are load switching, fuse clearing, utility switching, arcing contacts etc.

Manuscript published on 30 December 2013.

* Correspondence Author (s)

Er.Abinash Singh*, Electrical Engineering Department ,PEC University of Technology, Chandigarh, India.

Dr.Balwinder Singh Surjan, Electrical Engineering Department ,PEC University of Technology, Chandigarh, India.

© The Authors. Published by Blue Eyes Intelligence Engineering and Sciences Publication (BEIESP). This is an open access article under the CC-BY-NC-ND license <http://creativecommons.org/licenses/by-nc-nd/4.0/>.

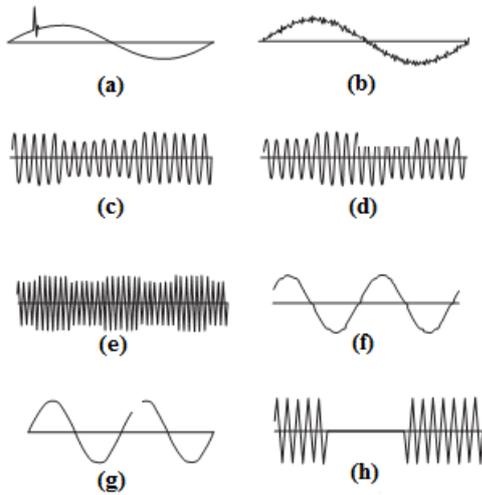


Fig. 1. Power Quality Problems

b) **EMI:** It can be depicted from Fig. 1(b) and is defined as the repetitive low energy disturbances in the 10 kHz to 1 GHz band, with 100 μ V to 100 V amplitude. It can be caused by normal equipment operation (switching power supplies, motor speed controllers etc) carrier power line communication and wireless broadcasting.

c) **SAG:** It is defined as the decrease in voltage between 0.1pu to 0.9pu and it can be seen in Fig. 1(c). It is due to the starting of heavy load, utility switching and ground fault.

d) **Swell:** An increase in voltage between 1.1pu to 1.8pu can be termed as swell as shown in Fig. 1(d). The main causes of swell are load reduction, utility switching.

e) **Flicker:** Small repetitive fluctuation in voltage level is called flicker. Flicker has been shown in Fig. 1(e). Pulsating load is its main cause.

f) **Notches:** It is known as repetitive dips in the line voltage, with short durations and it can be seen in Fig. 1(f). The main reasons for its occurrence are current commutation in controlled or uncontrolled three-phase rectifier circuit.

g) **Waveform distortion:** The deviation from ideal sine wave due to the presence of harmonics or inter harmonic is called as waveform distortion. Fig. 1(g) represents waveform distortion. It can be caused by rectifiers, phase-angle controllers, other nonlinear and/or intermittent loads.

h) **Outage:** Zero-voltage condition of a single phase or several phases in a multi-phase system, for more than a half-period is known as outage and can be seen from Fig. 1(h). Load equipment failure, ground fault, utility equipment failure, accidents, lightning and other acts of nature are major causes of outage.

B. The Influence of Power Quality Problems

Power quality problem is definitely harmful for both the power system and customers having various influences as :

- 1) There is reduction in the efficiency and life span of the generating equipment, transmission line and electrical equipment due to additional loss of power system device.
- 2) There is overheating in some part of transformer being produced by mechanical vibration, noise and overvoltage.
- 3) There is an increase in false tripping and maloperation of relay protection and automation which can lead to inaccurate measurement of electric testing instrument.
- 4) There is production of noise due to any disturbance on telecommunication system and even interfere the

communication quality, or sometimes it could cause message dropping.

- 5) There can be overheating, ageing of insulation, life-span shortening and even damages in capacitor and transmission line due to harmonic production and these harmonics also causes parallel resonance and series resonance in part of power system.

FACTS are power electronics based and other static controller to enhance controllability and increase power transfer and provide control of one or more ac transmission system parameters as defined in IEEE definitions and standards [6],[7].

III. ROLE OF FACTS DEVICES

Flexible Alternating Current Transmission Systems (FACTS) devices have been proposed for effective power flow control and regulating bus voltage in electrical power systems, thus resulting in an increased transfer capability, low system losses and improved stability.

A. Types of FACTS devices or FACTS controllers:

(a) **Shunt FACTS Controller:** The shunt controllers are connected in parallel with the transmission line. They inject the voltage and current in parallel with the transmission system.

(i) Static Synchronous Compensator:

According to IEEE definitions and standards, a static synchronous generator operated as a shunt connected static var compensator whose capacitive or inductive o/p current can be controlled independent of ac system voltage.

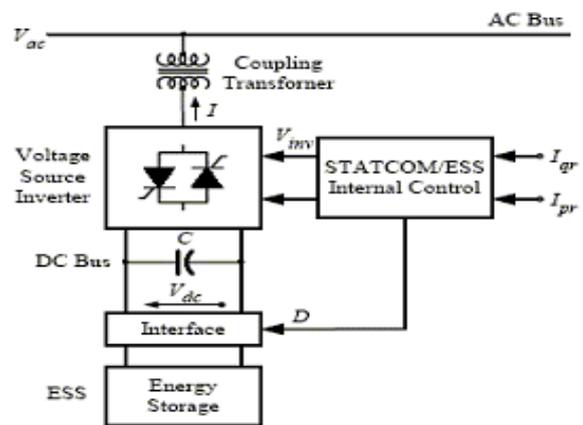


Fig. 2. Static Synchronous Compensator

A *STATic synchronous COMPensator* (STATCOM) as shown in Fig. 2, emulates an inductive or a capacitive reactance at the point of connection with the transmission line by injecting sinusoidal current, of variable magnitude, at the point of connection in quadrature with the line voltage. The line voltage regulation can be achieved by regulating the reactive current flow through STATCOM which has been verified by the modelling technique of STATCOM using an *Electromagnetic Transients Program*(EMTP) simulation package [9]. Distribution static compensator (DSTATCOM) is used in distribution system for the compensation of reactive power and unbalance caused by various loads and it works on the principle of VSC (voltage source converter).



To compensate the reactive power a current injected into the system by D-STATCOM to correct the voltage sag, swell and interruption . DSTATCOM is shown below in Fig. 3.

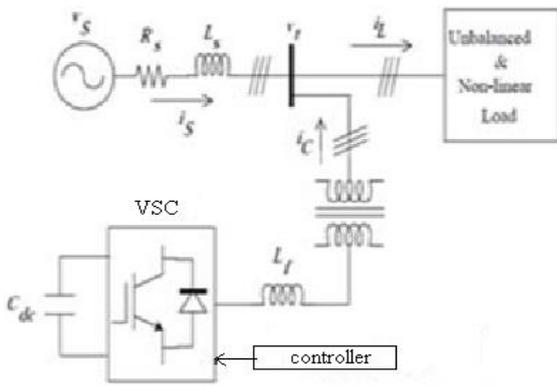


Fig. 3. Distribution STATic COMPensator

An efficiently controlled DSTATCOM can be used to compensate the reactive power and unbalance. The DSTATCOM's performance is dependent on the control algorithm used for extraction of reference current components [10].

A test system with/without DSTATCOM and a Battery Energy Storage System (BESS) has been done using Simulink and SimPower System in MATLAB environment for a wide variety of system disturbances under different tested conditions [11].

A paper has been published describing implementation of a neural-network (NN)-controlled DSTATCOM using a dSPACE processor for power quality improvement in a three-phase four-wire distribution system and its performance has been analysed in MATLAB [12].

For improving the power quality of power systems dynamic modeling and the control design of a distribution static compensator coupled with ultra-capacitor energy storage (UCES) has also been proposed and the control technique employed is based on the instantaneous power theory on the synchronous-rotating *dq* reference frame. Three modes of operation have been considered, i.e. voltage control for voltage fluctuations ride-through, current/voltage harmonics mitigation and dynamic active power control [13].

A mathematical model of DSTATCOM in voltage sag compensation mode along with SVPWM switched DSTATCOM simulation in power factor control mode has been presented for power factor and voltage sag compensation [14].

DSTATCOM can also be applied to industrial systems for mitigation of voltage dip problem which generally occurs during the starting of an induction motor [15].

The distribution system performance under all types of fault can be improved by using a 12-pulse DSTATCOM configuration with IGBT which can be modeled and simulated using the PSCAD/EMTDC [16].

A DSTATCOM can also be applied in three-phase, four-wire distribution system feeding commercial and domestic consumers for load balancing, neutral current elimination, power factor correction and voltage regulation [17].

To maintain voltage stability and improve power quality of distribution grid, a control strategy combining control of state feedback and feed forward has been employed using a nonlinear dynamic mathematical model of DSTATCOM and

thus improving the transient response performance and anti-disturbing ability of the system [18].

A three-level voltage inverter based dynamic model of DSTATCOM has been established by way of lead-in switch function and using PWM current control technology for realizing dynamic var compensation effectively [19].

A three-leg voltage source inverter (VSI) configuration with a dc bus capacitor as a DSTATCOM has been demonstrated through MATLAB/SIMULINK for power quality improvement in a three-phase, three-wire distribution system . Different control strategies have been employed and compared like hysteresis control, PWM current controllers , PI controller and sliding mode controller [20].

In order to balance the supply current, and improving the power factor to a desired value the theory of instantaneous symmetrical components has been used here to extract the three-phase reference currents and then these reference currents are then tracked using voltage source inverter (VSI), operated in a hysteresis band control technique [21]. The nonlinear state-space model of the multilevel DSTATCOM has been presented from the dq0 reference frame that can adapt to load changes and have effective steady-state compensation and a better dynamic response [22].

(ii) Static VAR Compensator:

According to IEEE definitions and standards, a shunt connected static VAR generator or absorber whose output is adjusted to exchange capacitive or inductive current so as to maintain or control specific parameters of the electrical power system.

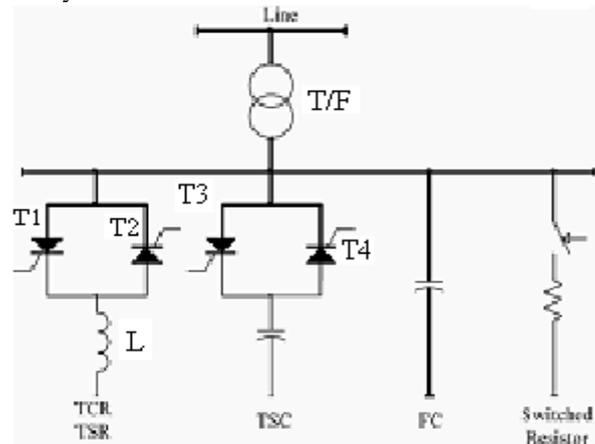


Fig. 4. Static VAR Compensator

Static VAR compensator (SVC) can be seen in Fig. 4. A comparative power flow study using SVC and STATCOM models on IEEE 14-Bus Test Network has been carried out and it has been shown that in both cases, the state variables of SVC and STATCOM have been combined with the bus voltage magnitudes and the angles of the network for Newton Power flow solution for achieving power quality and stability [23].

(b) Series FACTS Controller: These controllers are connected in series with the transmission line and they inject the voltage and current in series with the transmission system.

(i) Static Synchronous Series Compensator:

According to IEEE definitions and standards, a static synchronous generator or dynamic voltage restorer operated without an external electrical energy source or a series compensator where o/p voltage is in quadrature and controllable independently of the line current for the purpose of increasing or decreasing the overall reactive voltage drop across the line and there by controlling the transmitted electric power. SSSC is also known as dynamic voltage restorer. The DVR was first installed in 1996 and is shown in Fig. 5.

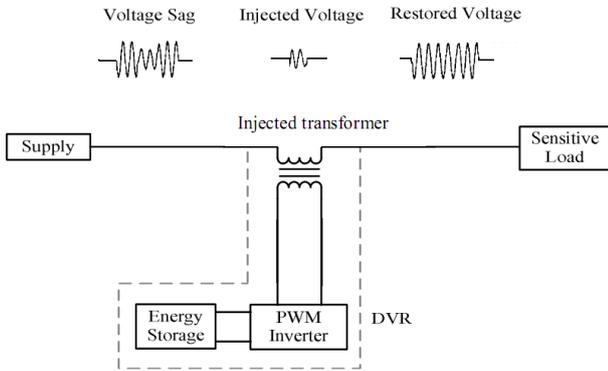


Fig. 5. Static Synchronous Series Compensator

DVR is useful for compensating voltage quality problems that are due to voltage sag. Due to its excellent dynamic capabilities, it is well suited to protect critical or sensitive load from short duration voltage dips or swells. When a fault occurs in a distribution network, a sudden voltage dip will appear on adjacent load feeders. With a DVR installed on a critical load feeder, the line voltage is restored to its nominal value within the response time of a few milliseconds thus avoiding any power disruption to the load [24], [25]. DVR protects loads against voltage sags by series injection of the missing portion of the utility voltage. To obtain missing voltage the distorted source voltage is compared with its pre-fault value to generate the control signal for PWM. The size and rating of DVR depend on its capability in supplying or absorbing real power in the steady-state [26]. Dynamic Voltage Restorer (DVR) is normally installed in a distribution system between the supply and the critical load feeder. Its primary function is to rapidly boost up the load-side voltage in the event of a disturbance in order to avoid any power disruption to that load. There are various circuit topologies and control schemes that can be used to implement a DVR [27]. To compensate the voltage deviation caused in a feeder the Interline DVR (IDVR) operated by Multiple Pulse Width Modulation (PWM) has been proposed which consists several DVRs connected to different distribution feeders in the power system sharing a common energy storage. One DVR in the IDVR system works in voltage-sag/swell compensation mode while the other DVR in the IDVR system operate in power-flow control mode [28]. GA-based optimization can be used for the location, the type and the rating of the various FACTS devices like static var compensator, static compensator, and dynamic voltage restorer and the performance of the proposed algorithm has been tested and illustrated on 295-bus generic distribution system [29].

A schematic diagram of IDVR has been shown in Fig. 6.

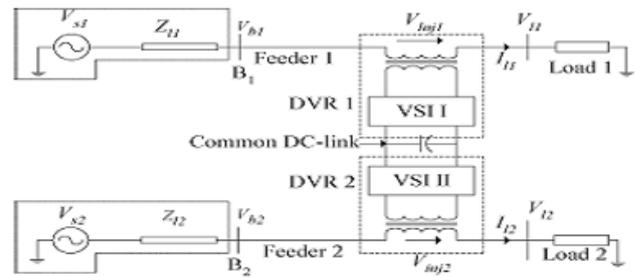


Fig. 6. Schematic diagram of an IDVR

A concept of interline dynamic voltage restoration (IDVR) has been proposed in which several DVRs in different feeders are connected to a common DC-link energy storage and thus reducing the cost of installation. For both the voltage control and the power flow control modes a closed-loop controller that consists of an inner current loop and an outer voltage loop has been incorporated into the IDVR system [30].

(iii) Thyristor Controlled Series Capacitor:

According to IEEE definitions and standards, a capacitive reactance compensator which consists of series capacitor bank shunted by thyristor controlled reactor in order to provide a smoothly variable series capacitive reactance. Fig. 7 shows a Thyristor Controlled Series Capacitor.

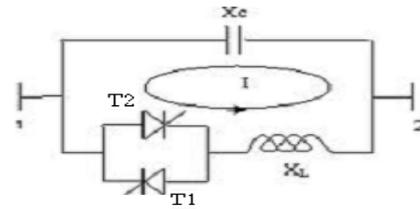


Fig. 7. Thyristor Controlled Series Capacitor

Thyristor Controlled Series Capacitor (TCSC) has been modeled in a simple two bus system with distributed parameter line. A Fuzzy logic controller and a PID controller have been used to control firing angles of TCSC but it has been verified that the fuzzy logic controller can generate better dynamic response [31]. A single-machine infinite-bus power system installed with a TCSC has been proposed whose control parameters have been optimized using genetic algorithm. The modelling and simulation have validated the effectiveness of the proposed approach to achieve system stability [32]. The TCSC controller can provide a very fast action to increase the synchronization power by quick change in the equivalent capacitive reactance to the full compensation during a fault. The TCSC controller can be designed to control the power flow, to increase the transfer limits or to improve the transient stability and damping the oscillations FACTS devices such as thyristor controlled series capacitors are difficult to model due to their nonlinear switching behaviour. It has been shown that passive damping has a significant effect on modal damping [33],[34]. As compared to the traditional control devices, the TCSC offers smooth and flexible control of the line impedance with much faster response. The Newton-Raphson ac power flow method has been used to perform the modeling of TCSC for power flow studies.



The performance of the proposed algorithm has been tested on IEEE-30 bus systems [35].

(c) **Combined series-series controllers:** These controllers have two series controllers which are connected in series with the transmission line coupled via common dc power link to transmit the current, voltage and power.

(i) **Interline Power Flow Controller:** According to IEEE definitions and standards, it consists of two or more SSSC which are coupled via common dc power link to facilitate bidirectional flow of real power between the ac terminals of SSSC. Interline Power Flow Controller (IPFC) can be seen in Fig. 8.

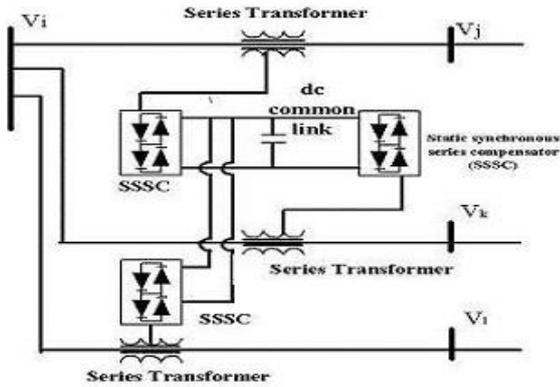


Fig. 8. Interline Power Flow Controller

IPFC is a new concept for an overall real and reactive compensation and effective power flow management of multi-line transmission systems by transferring the power from overloaded to under loaded lines. It consists of a number of inverters with a common dc link to facilitate real power transfer among the lines of transmission system. The prime inverters can be controlled to provide totally different operating functions, e.g., independent P and Q control, phase shifting (transmission angle regulation), transmission impedance control, etc [36],[37].

In order to analyse the flexibility of power flow control, the steady state operation of the IPFC has been investigated through its mathematical model using improved control strategies. A mathematical model based on the *d-q* orthogonal coordinates was developed to address the issues like the relationship between the transmission angle and the IPFC controlled region [38],[39].

The power injection model has been incorporated in Newton-Raphson (NR) power flow solution method on IEEE 14-bus system on the basis of a MATLAB program to demonstrate the performance of the IPFC model and its effects in power flow studies [40]. To verify the capability of IPFC in controlling the power flow in power system a case study has been conducted on 6-bus & 3-machine and 30-bus & 6-machine systems, and the results have been examined in the absence and presence of IPFC in the network [41].

A controller has been made using ATP- Electromagnetic Transients Program as study and investigation tool in which the IPFC employs two dc/ac inverter with a common DC-link to provide series compensation in the transmission system [42]. For improving the transient stability performance of power systems an integrated approach of radial basis function neural network (RBFNN) and Takagi-Sugeno (TS) fuzzy scheme with a genetic optimization of their parameters has been implemented on TCSC connected in a single-machine infinite bus power

system and then applied to IPFC connected in a multi machine power system [43].

An extended Heffron-Phillips model of a single machine infinite bus (SMIB) system installed with IPFC has been established and used to analyze the damping torque contribution of the IPFC in damping the low frequency oscillations and maintaining the control of the power system. Under various loading conditions the potential of various IPFC control signals has been investigated for the power system oscillation stability. To enhance the transient stability of the system a power oscillation damping controller has been designed for the IPFC using phase compensation technique. The eigen value analysis of the linearized Phillips-Heffron model have been used to identify the oscillation modes with low damping ratio. To control the power flow demand in the IPFC connected transmission lines additional power flow controllers have also been incorporated into the system [44]-[46].

Another Mathematical model of the IPFC has been presented to investigate the flexibility of power flow control, and the steady state operation of the Interline Power Flow Controller (IPFC) has been investigated in the presence of operating constraints of the IPFC [47].

In order to ensure a globally optimum control strategy in the Lyapunov sense, the newly developed IPFC energy functions has been implemented such that the magnitudes of the IPFC's series-injected voltages remain set to their maximum values and only the angles of these voltages change [48].

To investigate the inter-system oscillations, a linear model of VSC-based FACTS devices has been developed that takes into account the dynamics of dc links and then incorporated into a production-grade software for small signal analysis of large power systems [49].

For state estimation a model with IPFC has been introduced on the basis of conventional power system state estimation model, in which power injection model has been used and the effect of IPFC on the power flow has been transferred to the lines which are connected to it [50].

(d) **Combined Series and Shunt Connected Controller:** In these controllers, one controller is connected in series and another is connected in parallel and they both are coupled via a coordinated control and a common dc power link in transmission line to transmit the current, voltage and power.

(i) **Unified Power Flow Controller:** According to IEEE definitions and standards, Unified Power Flow Controller (UPFC) consists of STATCOM and SSSC which are coupled via common dc power link to allow bidirectional flow of real power between the series o/p terminals of the SSSC and shunt o/p terminals of the STATCOM. The basic structure of UPFC has been shown in Fig. 9.

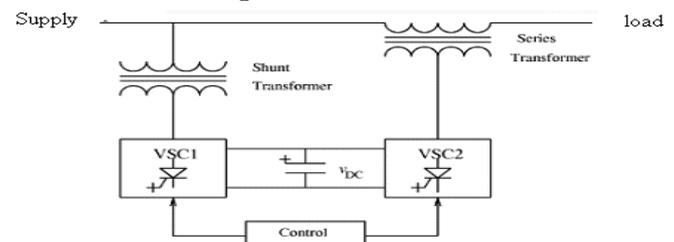


Fig. 9. Unified Power Flow Controller

The most promising FACTS device, UPFC, is capable of providing an adaptive voltage magnitude control as well as active and reactive power control and their regulation. A new mathematical model of UPFC incorporated in Newton-Raphson load flow algorithm has been developed. Voltage Stability Index has been used for optimal location of UPFC and Particle Swarm Optimization (PSO) technique has been used to set the parameters of UPFC being tested on IEEE 5-Bus and IEEE 14-Bus systems using MATLAB [51]. A numerical method tested with Matlab consisting of a set of equations for a system including the UPFC and an equivalent two bus power network has been successfully validated with analog model and EMTP [52].

The mathematical models for new UPFC series control modes have been presented which include direct voltage injection, bus voltage regulation, line impedance compensation and phase angle regulation [53].

In comparison with the classical decoupled control strategy, for better stability and transient performance a modified control structure with a predictive control loop and pre control signal has been designed for a dc-voltage control and control of harmonic current [54].

The selection of damping control signal for the design of UPFC damping controller and the effect of UPFC DC voltage regulator on power system oscillation stability and the have been studied and demonstrated on the Phillips–Heffron model [55].

The modeling of converter-based controllers in which two or more VSCs are coupled to a dc link like UPFC, IPFC and GUPFC has been presented for load-flow calculations [56]. The modeling and simulation of IEEE 30 bus system employing UPFC has been described with and without implementation of UPFC [57].

SVC, and UPFC have been explained and modelled. Integration of FACTS devices and wheeling transactions into SCADA systems have been investigated. PF and OPF algorithms have been used for incorporating different policies and accounting methods [58].

A comparison among the load flow results using three models of UPFC : decoupled UPFC model, injection UPFC model and comprehensive NR UPFC model have been incorporated in a MATLAB power flow program at different operation modes [59].

The dynamic behavior of IPFC & UPFC has been compared and rationalized by developing the small-signal models and validating them using detailed electromagnetic transients simulation [60]. To improve the dynamic performance of the power system, a nonlinear dynamic model of the network consisting UPFC has been established using linearisation and network reduction for transient studies and the decoupled control algorithms for active and reactive power have been developed [61].

To minimize the capacity of the shunt compensator and to maintain power flow control sensitivity the perpendicular voltage control model of UPFC has been proposed. The protection and control of UPFC model for transmission capability improvement have been verified using a real time analog simulator [62].

An approach to solve first-swing stability problem using UPFC, by using the local variable of system along with a comprehensive analysis has been presented for better stability performance [63].

A power flow study of a five bus system with and without UPFC has been carried out and has been implemented with

MATLAB to conclude that UPFC is able to control voltage, impedance, and phase angle [64].

MATLAB program has been used to model UPFC and to verify the performance of UPFC with different controllers like PID controller and ANFIS controller [65].

For the analysis of the steady state operation of Unified Power Flow Controller connected in a power system, an improved steady state mathematical model has been presented employing conventional techniques such as Newton-Raphson method and has been simulated on IEEE 30-bus systems using commercial software [66].

The modeling of the unified power flow controller (UPFC) on the IEEE 30-bus system and the IEEE 118-bus system has been presented to illustrate the feasibility and the performance of the system. The control modes including power flow, voltage, angle and impedance control functions have been incorporated into a Newton-Raphson power flow algorithm [67].

ii) Generalised Unified Power Flow Controller (GUPFC):.

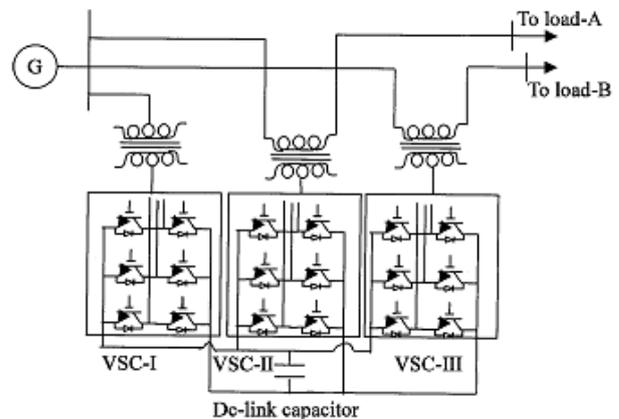


Fig. 10. Generalised Power Flow Controller

As shown in Fig. 10, a Generalized Unified Power Flow Controller consists of three or more converters out of which one is shunt connected while the remaining converters are series connected, resulting in the control of both real and reactive power flow in the line and to provide flexibility and additional degrees of freedom. The shunt connected converter not only provides the necessary power required, but also the reactive current injected at the converter bus. A novel concept of a similar mathematical model for the GUPFC on the IEEE 30 bus power system demonstrating the feasibility as well as the effectiveness of the GUPFC in the OPF method has been presented [68].

Compared with the conventional application of the UPFC, the GUPFC have shown great advantages. For the desired power flow distribution in Sichuan power grid, and also the voltage control of a substation a control law for the four-converter GUPFC has been proposed [69].

Mathematical models of the IPFC and GUPFC and their implementation in Newton power flow based on the IEEE 30-bus and 300-bus systems have been presented to demonstrate the performance of these FACTS devices [70].

IV. CONCLUSION

After going through this review based on the given title, we conclude that the different FACTS devices give better performance and good control of the parameters of power system by mitigating power quality problems. Among the various techniques/ FACT devices, the Combined Controllers like IPFC, UPFC, GUPFC gives better results than rest of the FACT devices because it gives more degrees of freedom, minimum errors and faster operation after optimization of various parameters of facts devices to improve and protect the parameters of power system and thus help to maintain power quality and better power flow.

REFERENCES

- [1] A.Kusko, M.T.Thompson, "Power quality in electrical system", third edition, McGraw-Hill, 2007.
- [2] D.M.Vilathgamuwa, H.M.Wijekoon and S.S.Choi, "Investigation of Resonance Phenomena in a DVR Protecting a Load with PF Correction Capacitor", IEEE Power Electronics and Drives Systems Conference, vol.1, Nov. 2003, pp.811 – 815.
- [3] F.A.L.Jowder "Design and analysis of dynamic voltage restorer for deep voltage sag and harmonic compensation", Published in IET Generation, Transmission & Distribution, vol. 3, June 2009, pp. 547-560.
- [4] M.Tümay , A.Teke , K.Ç. Bayındır ,M.U.Cuma , "Simulation and modeling of a dynamic voltage restorer" Adana, Turkey, vol.3, 2002, pp.31-35.
- [5] G.V.N.Kumar D.D. Chowdary, "DVR with Sliding Mode Control to alleviate Voltage Sags on a Distribution System for Three Phase Short Circuit Fault" , IEEE Region 10 Colloquium and the Third International Conference on Industrial and Information Systems, Dec.2008, pp.1-4.
- [6] Narain G. Hingorani, Laszlo Gyugyi "Understanding FACTS: Concepts and Technology of Flexible AC Transmission Systems" Wiley-IEEE Press, December 1999.
- [7] K.R.Padiyar, "FACTS: Controllers in Power Transmission and Distribution", New Age, 2007.
- [8] B. Fardanesh, B. Spherling, E.Uzunovic, S. Zelingher, "Multi-Converter FACTS Devices: The Generalized Unified Power Flow Controller (GUPFC)", Power Engineering Society Summer Meeting, IEEE , vol. 2, 2000, pp. 1020 – 1025.
- [9] Kalyan K. Sen, "STATCOM - STATic synchronous COMPensator: Theory, Modeling, and Applications" , Power Engineering Society 1999 Winter Meeting, IEEE, vol.2 ,1999, pp. 1177 – 1183.
- [10] Pradeep Kumar, "Simulation of Custom Power Electronic Device D-STATCOM –A Case Study", IEEE, International Conference on Power Electronics, India, 2011, pp. 1-4.
- [11] Alka Singh, Suman Bhowmick, Kapil Shukla, " Load Compensation with DSTATCOM and BESS", IEEE 5th India International Conference on Power Electronics (IICPE), 2012, pp.1-6.
- [12] Bhim Singh, P.Jayaprakash, Sunil Kumar, D.P Kothari , "Implementation of Neural-Network-Controlled Three-Leg VSC and a Transformer as Three-Phase Four-Wire DSTATCOM", IEEE Transactions on Industry Applications, vol. 47, no. 4, July/August 2011
- [13] M.G. Molina, P.E.Mercado, " Dynamic Modeling and Control Design of DSTATCOM with Ultra-Capacitor Energy Storage for Power Quality Improvements ", Transmission and Distribution Conference and Exposition: Latin America , IEEE, Aug. 2008, pp. 1-8.
- [14] Bishnu P. Muni, S. Eswar Rao, and JVR Vithal, "SVPWM Switched DSTATCOM for Power Factor and Voltage Sag Compensation "International conference on Power Electronics, Drives and Energy Systems, IEEE, 2006, pp. 1-6.
- [15] Bhim Singh, A. Adya, A.P.Mittal, J.R.P.Gupta and B.N.Singh, "Application of DSTATCOM for Mitigation of Voltage Sag for Motor Loads in Isolated Distribution Systems", IEEE ISIE, Montreal, Quebec, Canada, July 9-12, 2006.
- [16] S. H. Hosseini, A. Nazarloo and E. Babaei, "Application of D-STATCOM to Improve Distribution System Performance with Balanced and Unbalanced Fault Conditions", Electrical Power & Energy Conference ,Electric Power and Energy Conference, IEEE, 2010, pp. 1-6.
- [17] Bhim Singh, A.Adya, A.P.mittal and J.R.P Gupta, " Modeling and Control of DSTATCOM for Three-Phase, Four-Wire Distribution Systems", Industry Application Conference, IEEE, Vol. 4, 2005, pp. 2428 – 2434.
- [18] Yubin Wang, Jiwen Li, Yan Lv and Xuelian Liu, " Modeling and Controller Design of Distribution Static Synchronous Compensator", International Conference on Power System Technology, 2006.
- [19] Zhang Dongliang, Li Guoxin, Wang Chonglin, Tang Jiejie, Cao Weiwei, "Modeling and Simulation of DSTATCOM Based On Switch Function", IEEE Conference on Industrial Electronics and Applications, 2009, pp. 2297-2301.
- [20] Bhim Singh, Alka Adya, A.P.Mittal, and J.R.P. Gupta, "Modeling, Design and Analysis of Different Controllers for DSTATCOM", Power System Technology and IEEE Power India Conference, 2008, pp.1-8.
- [21] Dinesh Kumar, Rajesh, " Modelling, Analysis and Performance of a DSTATCOM for Unbalanced and Non-Linear Load", IEEE/PES Transmission and Distribution Conference & Exhibition, China , 2005.
- [22] Xiao-ping Yang, Hai-bin Hao, Yan-ru Zhong, "The State-Space Modeling and Nonlinear Control Strategies of Multilevel DSTATCOM", IEEE Power and Engineering Conference, 2010, pp. 1-4.
- [23] Bahadur Singh Pali, Suman Bhowmick, Narendra Kumar, "Power Flow Models of Static VAR Compensator and Static Synchronous Compensator", IEEE Power India Conference , 2012, pp. 1-5.
- [24] J.G.Nielsen, M.Newman, H.Nielsen, and F.Blaabjerg "Control and Testing of a Dynamic Voltage Restorer (DVR) at Medium Voltage Level", IEEE transactions on power electronics, vol. 19, no. 3, May 2004, pp.1248 – 1253
- [25] H.Zhou, T.Z.Wei, Y.Zhao, Z.P.Qi , "Study on Dynamic Matrix Predictive Control of single-phase DVR", Electric Utility Deregulation and Restructuring and Power Technologies, DRPT, April.2008, pp. 2136 - 2140
- [26] B.W.Kennedy, "Power Quality Primer", second edition , McGraw-Hill ,2000
- [27] D.M.Vilathgamuwa and H.M.Wijekoon, "Mitigating Zero Sequence Effects in Dynamic Voltage Restorers", IEEE ,Power Electronics Specialists Conference, 2007, pp.3079 – 3085.
- [28] Usha Rani P., Sudha R., Dr. S. Rama Reddy, " Voltage Sag/Swell Compensation in an Interline Dynamic Voltage Restorer", Proceedings of ICETECT, IEEE, 2011, pp. 309-314.
- [29] Yan Zhang and Jovica V. Milanovic, " Global Voltage Sag Mitigation With FACTS-Based Devices", IEEE Transactions on Power Delivery, vol. 25, no. 4, October 2010, pp.2842-2850.
- [30] H.M. Wijekoon, D.M. Vilathgamuwa and S.S. Choi, " Interline dynamic voltage restorer: an economical way to improve interline power quality", IEE Proceedings on Generation Transmission and Distribution., Vol. 150, No. 5, September 2003, pp.513-520.
- [31] U.Yolac, T. Yalcinoz, "Comparison of Fuzzy logic and Pid Controllers for Tcsc using Matlab", Universities Power Engineering Conference, vol. 1, Sep. 2004, pp. 438-442.
- [32] Sidhartha Panda and Narayana Prasad Padhy "MATLAB/SIMULINK Based Model of Single-Machine Infinite-Bus with TCSC for Stability Studies and Tuning Employing GA", International Journal of Electrical and Electronics Engineering ,2007
- [33] Vasundhara Mahajan, " Thyristor Controlled Series Compensator", IEEE International Conference on Industrial Technology, 2006, pp. 182-187.
- [34] Brian K. Perkins, M.R. Iravani, " Dynamic Modeling of a TCSC with Application to SSR Analysis", IEEE Transactions on Power Systems, Vol. 12, No. 4, November 1997, pp. 1619-1625.
- [35] Abdel Moamen M. A, Narayana Prasad Padhy, "Newton-Raphson TCSC Model for Power Flow Solution of Practical Power Networks", Power Engineering Society Summer Meeting, IEEE, 2002, pp. 1488-1493.
- [36] Laszlo Gyugyi, Kalyan K.Sen, Colin D.Schauder, " The Interline Power Flow Controller Concept: A New Approach To Power Flow Management In Transmission Sytems", IEEE Transactions on Power Delivery, Vol. 14, No.3 , July 1999, pp.1115-1125.
- [37] Akhilesh A. Nimje , Chinnmoy Kumar Panigrahi , Ajaya Kumar Mohanty, " Interline Power Flow Controller: Review Paper", International Electrical Engineering Journal (IEEJ) Vol. 2 , No. 3,,2011, pp. 550-554.
- [38] V.Diez-Valencia, U.D.Annakkage, D.Jacobson, "Interline Power Flow Controller (Ipfc) Steady State Operation", Proceedings of the IEEE Canadian Conference on Electrical & Computer Engineering, vol.1, 2002, pp.280-284.

- [39] R.L. Vasquez-Arnez F.A. Moreira, "The Interline Power Flow Controller: Further Aspects Related to its Operation and Main Limitations", IEEE Transmission and Distribution Conference and Exposition, 2008, pp. 1-6.
- [40] A.V.Naresh Babu and S.Sivanagaraju, "Mathematical Modelling, Analysis and Effects of Interline Power Flow Controller (IPFC) Parameters in Power Flow Studies", IEEE International conference on Power Electronics, 2011, pp. 1-7.
- [41] Alireza.Dehghanpour , S.M.H. Hosseini and N.Talebi, "Power Flow Management by IPFC in transmission system", IEEE Control and System Graduate Research Colloquium, 2011, pp. 32-36.
- [42] D. Menniti, A. Pinnarelli, N. Sorrentino, "A fuzzy logic controller for Interline Power Flow Controller model implemented by ATP-EMTP", IEEE International Conference on Power System Technology, vol. 3, 2002, pp.1898-1903.
- [43] S. Mishra, P. K. Dash, P. K. Hota, and M. Tripathy, "Genetically Optimized Neuro-Fuzzy IPFC for Damping Modal Oscillations of Power System", IEEE transactions on power systems, vol. 17, no. 4, November, 2002, pp. 1140-1147.
- [44] Alivelu M. Parimi , Irraivan Elamvazuthi and Nordin Saad, "Interline Power Flow Controller (IPFC) Based Damping Controllers for Damping Low Frequency Oscillations in a Power System", IEEE International Conference on Sustainable Energy Technologies, 2008, pp. 334-339.
- [45] Jitendar Veeramalla, Sreerama Kumar.R, "Application of Interline Power Flow Controller (IPFC) for Damping Low Frequency Oscillations in Power Systems" Modern Electric Power Systems Proceedings of International Symposium, Poland., 2010, pp. 1-6.
- [46] A.livelu M.Parimi,N.C.Sahoo, I. Elamvazuthi, and Nordin Saad, "Transient Stability Enhancement and Power Flow Control in a Multi-Machine Power System Using Interline Power Flow Controller", IEEE International Conference on Energy Automation and Signals, 2011, pp. 1-6.
- [47] V. Diez-Valencia, U.D. Annakkage, A.M Gole, P. Demchenko, D. Jacobson , "Interline Power Flow Controller (Ipfc) Steady State Operation", Proceedings of the IEEE Canadian Conference on Electrical & Computer Engineering, 2002, pp. 280-284.
- [48] Valentin Azbe, Rafael Mihalic, "The Control Strategy for an IPFC Based on the Energy Function", IEEE Transactions on Power Systems, vol. 23, no. 4, November 2008, pp. 1662-1669.
- [49] F. R. Segundo, A. R. Messina, "Modeling and Simulation of Interline Power Flow Controllers: Application to Enhance System Damping", North American Power Symposium, USA, 2009, pp. 1-6.
- [50] V.Gomathi, V.Ramachandran, C.Venkaresh Kumar, "Simulation and State Estimation of Power System with Interline Power Flow Controller", Universities Power Engineering Conference, 2010, pp. 1-6.
- [51] T.Nireekshana, Dr.G.Kesava Rao, .S.Siva Naga Raju, "Incorporation of Unified Power Flow Controller Model for Optimal Placement using Particle Swarm Optimization Technique", IEEE International Conference on Electronics Computer Technology ,2011, pp. 209-214.
- [52] A.J.F.Keri, A.S.Mehraban, X.Lombard, A.Elriachy, A.A. Edris, "Unified Power Flow Controller (UPFC): Modeling and Analysis", IEEE Transactions on Power Delivery, Vol. 14, No. 2, April 1999, pp. 648-654.
- [53] Xiao-Ping Zhang and Keith R Godfrey, "Advanced Unified Power Flow Controller Model for Power System Steady State Control", IEEE International Conference on Electric Utility Deregulation, Restructuring and Power Technologies, Hong Kong, vol. 1, 2004, pp. 228-233.
- [54] I. Papic, P. Zunko, D. Povh, M. Weinhold, "Basic Control of Unified Power Flow Controller", IEEE Transactions on Power Systems, Vol. 12, No. 4, November, 1997, pp. 1734-1739.
- [55] HaiFeng Wang, "A Unified Model for the Analysis of FACTS Devices in Damping Power System Oscillations—Part III: Unified Power Flow Controller", IEEE transactions on power delivery, vol. 15, no. 3, July, 2000, pp. 978-983.
- [56] Xia Jiang, Xinghao Fang, Joe H. Chow, Abdel-Aty Edris, Edvina Uzunovic, Michael Parisi, and Liana Hopkins, "A Novel Approach for Modeling Voltage-Sourced Converter-Based FACTS Controllers", IEEE Transactions on Power Delivery, vol. 23, no. 4, October 2008, pp. 2591-2598.
- [57] P.Kannan and S. Chenthur Pandian, "Case Study on Power Quality Improvement of Thirty Bus System with UPFC", International Journal of Computer and Electrical Engineering, Vol. 3, No. 3, June 2011.
- [58] H. V. Hitzeroth, D. Braisch, G. Herold, D. Povh, "Compensation, Stability and Losses in the Presence of Wheeling Transactions with use of FACTS Devices", IEEE International Conference on Electric Power Engineering, Sep. 1999.
- [59] M. Z. EL-S'adek, A. Ahmed, H. E. Zidan, "Comparison Of Unified Power Flow Controller Models For Power Flow Studies", IEEE International Middle East Power System Conference, 2006, pp. 189-196.
- [60] Shan Jiang, Ani M. Gole, Udaya D. Annakkage, "Damping Performance Analysis of IPFC and UPFC Controllers Using Validated Small-Signal Models", IEEE Transactions on Power Delivery, vol. 26, no. 1, January 2011
- [61] K.S.Smith, L. Ran, J. Penman, "Dynamic modelling of a unified power flow controller", IEE Proceedings on Generation Transmission and Distribution, Vol. 144, No. 1, January 1997, pp. 7-12.
- [62] Yasuo Morioka, Yasuhiro Mishima, Yoshiki Nakachi, "Implementation of Unified Power Flow Controller and Verification for Transmission Capability Improvement", IEEE Transactions on Power Systems, Vol. 14, No. 2, May 1999, pp. 575-581.
- [63] Eskandar Gholipour and Shahrokh Saadate, "Improving of Transient Stability of Power Systems Using UPFC", IEEE Transactions on Power Delivery, vol. 20, no. 2, April 2005, pp. 1677-1682.
- [64] Ashwin Kumar Sahoo, S.S. Dash, T. Thyagarajan, "Modeling Of Statcom And Upfc For Power System Steady State Operation And Control", IET-UK International Conference on Information and Communication Technology in Electrical Sciences (ICTES), 2007, pp.458-463.
- [65] N.K.Sharma, P.P.Jagtap, "Modelling and application of Unified Power Flow Controller (UPFC)", Third International Conference on Emerging Trends in Engineering and Technology, IEEE, 2010, pp. 350-355.
- [66] A.M. Vural, M. Tumay, "Steady State Analysis of Unified Power Flow Controller: Mathematical Modeling and Simulation Studies", IEEE Bologna Power Tech Conference, vol.4, Italy, 2003.
- [67] Wenjin Dai, Zhihong Liu, "Study on Modeling of Unified Power Flow Controller", Proceedings of the IEEE International Conference on Automation and Logistics, China, August , 2007, pp. 373-377.
- [68] Rakhmad Syafutra Lubis, Sasongko Pramono Hadi, and Tumiran, "Modeling of the Generalized Unified Power Flow Controller for Optimal Power Flow", International Conference on Electrical Engineering and Informatics, Bandung, Indonesia, July 2011, pp. 1-6.
- [69] Lin Sun, Shengwei Mei, Qiang Lu and Jin Ma, "Application of GUPFC in China's Sichuan Power Grid - Modeling, Control Strategy and Case Study", IEEE Power Engineering Society General Meeting, vol. 1, 2003, pp. 175-181.
- [70] X.-P. Zhang, "Modelling of the interline power flow controller and the generalised unified power flow controller in Newton power flow", IEE Proceeding on Generation Transmission and Distribution, vol. 150, 2003, pp. 268-274.



Abinash Singh is a research scholar in the Electrical Engineering Department, PEC University of Technology, Chandigarh "formerly Punjab Engineering College, Chandigarh". The author received B.Tech. (Electrical) in 2008 from Punjab Technical University, Jalandhar , M.E (Electrical Engineering) from PEC University of Technology, Chandigarh and is now pursuing Ph.D. under the guidance of Dr.Balwinder Singh Surjan ,on regular basis in the same institute. He has two years of professional teaching experience to undergraduate students in Punjab Technical University. His areas of interest are power system and power quality improvement.



Surjan Balwinder Singh is Associate Professor in the Electrical Engineering Department, PEC University of Technology, Chandigarh "formerly Punjab Engineering College, Chandigarh". The author received B.E. (Electrical) in 1989, M. Tech. (Power Apparatus & Systems) in Feb 1991, and Ph.D. degrees in 2008, from Shivaji University Kolhapur, I.I.T. Bombay, and Panjab University Chandigarh respectively. He has twenty years of professional teaching experience in the same institute. He has taught undergraduate and post graduate students. He has guided number of post graduate theses mainly in the field of power system stability studies also in field of photometric analysis of luminaires. His areas of interest include power system stability studies, illumination engineering, machine applications, modeling and analysis. The author is member of professional societies like IEEE, Indian Society of Lighting Engineering (M), Fellow Institution of Engineers (I), Chartered Engineer IE (I).

