

Converting Fuel Oil to Gas in Combustion System for CO₂ Emission Mitigation at PT. PJB UP Gresik

Rita Anitasari, Rizki Fitriani, Erna Triastutik, Alief Makmuri Hartono, Totok R. Biyanto

Abstract— *In environmental point of view, natural gas is the cleanest of the fossil fuels. The combustion of natural gas releases virtually no sulphur dioxide and ash or particulate matter, and very small amounts of nitrogen oxides. Natural gas emits 22% less carbon dioxide than oil and 40% less than coal. NO_x is reduced by more than 90% and SO_x by more than 95%. This paper will describes the effort of PT. PJB UP Gresik as the owner of the biggest steam power plant in Indonesia to reduce the CO₂ emission by converting fuel oil to gas at existing steam power plant fuel system. In order to achieve operating conditions that assure mass, energy and momentum balances, some plant modifications and new installation were performed in combustion system area. The effort was performed successfully. The evidents were compare with the same powerplant in the world. In term of CO₂ emission, PT. PJB UP Gressik lay at the best ten compared to others power plant performance in America. It is shown PT. PJB UP Gresik have been performing best green practice especially in reducing CO₂ emmission in the steam power plant by utilize fuel gas.*

Index Terms—CO₂ Emission, Mitigation, Combustion System, Converting Fuel Oil to Gas

I. INTRODUCTION

Nowaday, becoming green is a matter of responding to the expectations and demands of our world, country, community, stockholders, customers, employees and competitors as well as a matter of compliance with regulations. These issues create tremendous pressure for companies to carry out their activities in a more environmental friendly [1].

Being green requires the best engineering minds and commitment from the entire organization. Engineering is all about practicality finding solutions to improve the conditions. Perform practical solutions that have a large impact to society, i.e. air pollution, carbon capture and storage, CO₂ emissions and renewable energy. Develop and apply the new processes that reduced waste and vent streams, reduced energy consumption, minimized environmental impact, etc. One of the practice converting fuel oil to gas in

power plant's combustion sysmtem [1]. It is well known that different fuels emit different amounts of carbon dioxide (CO₂) when burned. Pounds of CO₂ emitted per million British thermal units (Btu) of energy for various fuels, such as diesel fuel oil and natural gas (gas) emit 161.3 and 117.0 pound of CO₂, respectively [2].

The amount of CO₂ produced by a fuel is mainly determined by the carbon (C) and hydrogen (H) content of the fuel. Heat is produced when C and H combine with oxygen (O) during combustion. Natural gas is primarily methane (CH₄), which has a higher energy content relative to other fuels, and thus, it has a relatively lower CO₂ to energy ratio. Water and various elements, such as sulfur and noncombustible elements in some fuels reduce their heating values and increase their CO₂ to heat ratio of contents [2].

Converting a combustion engine to operate on gaseous fuel improves fuel efficiency in three ways i.e natural gas burns efficiently due to highest energy content fossil fuel, Natural gas burns cleanly, hence— it provides lower maintenance costs and emissions (reduced fees, carbon finance), and it is attractively priced that produced more power for the same money [3]

In environmental point of view, natural gas is the cleanest of the fossil fuels. The combustion of natural gas releases virtually no sulphur dioxide and ash or particulate matter, and very small amounts of nitrogen oxides. Natural gas emits 22% less carbon dioxide than oil and 40% less than coal. NO_x is reduced by more than 90% and SO_x by more than 95% [4].

Frankly speaking, compliance with environmental regulations is one of main drivers for converting fuel to gas operation. In order to acchive the aims, retrofitting of existing fuel oil into gas operation are increasingly being looked into in the steam power plants [5].

This paper will describes the effort of PT. PJB UP Gresik as the owner of the biggest steam power plant in Indonesia to reduce the CO₂ emission by converting fuel oil to gas at existing steam power plant fuel system.

II. THEORY

A. Heating Value

The fuel heating value is an amount of produced heat, when the complete combustion of a unit quantity of fuel are cooled to the initial temperature (298 K) of the air and fuel. Since the heating value of fuel increases, the delivered heat content to the burner increases.

Manuscript published on 30 August 2016.

* Correspondence Author (s)

Totok Ruki Biyanto*, Department of Physics, Institut Teknologi Sepuluh Nopember, Surabaya, Indonesia.

Rita Anitasari, Pembangkit Jawa Bali. PT (PJB) - UP. Gresik, Kabupaten Gresik, Jawa Timur 61112, Indonesia.

Rizki Fitriani, Pembangkit Jawa Bali. PT (PJB) - UP. Gresik, Kabupaten Gresik, Jawa Timur 61112, Indonesia.

Erna Triastutik, Pembangkit Jawa Bali. PT (PJB) - UP. Gresik, Kabupaten Gresik, Jawa Timur 61112, Indonesia.

Alief Makmuri Hartono, Pembangkit Jawa Bali. PT (PJB) - UP. Gresik, Kabupaten Gresik, Jawa Timur 61112, Indonesia.

© The Authors. Published by Blue Eyes Intelligence Engineering and Sciences Publication (BEIESP). This is an [open access](http://creativecommons.org/licenses/by-nc-nd/4.0/) article under the CC-BY-NC-ND license <http://creativecommons.org/licenses/by-nc-nd/4.0/>.

Converting Fuel Oil to Gas in Combustion System for CO₂ Emission Mitigation at PT. PJB UP Gresik

The heat of combustion of a fuel is also called its potential heat.

If a fuel is burned in oxygen saturated with water vapor, the quantity of heat released is known as the high heating value (HHV) or gross calorific value (GCV) of fuel. When the latent heat of water vapor contained in the combustion fuels is subtracted from the HHV, It obtains the low heating value (LHV) or net calorific value (NCV) of fuel. In the laboratories, the HHVs of solid and liquid fuels are determined at constant volume. In another hand, the HHVs of the gaseous fuels are determined at constant pressure. Combustion in a furnace, however, takes place at constant pressure [6].

energy and momentum balances, some plant modifications and new installation were performed in combustion system area, as follows;

1. Replace 6 conventional burners with Radially Stratified Flame Core (RSFC) burners
2. Modify valves and piping system
3. Install burner management system
4. Install gas receiving and measuring system
5. Replace Force Draft Fan (FDF)
6. Modify fire protection system
7. Modify Automatic Boiler Control (ABC) and Automatic Burner System (ABS)

The P&D of modified plant is shown in Figure 1.

III. METHODOLOGY

In order to achieve operating conditions that assure mass,

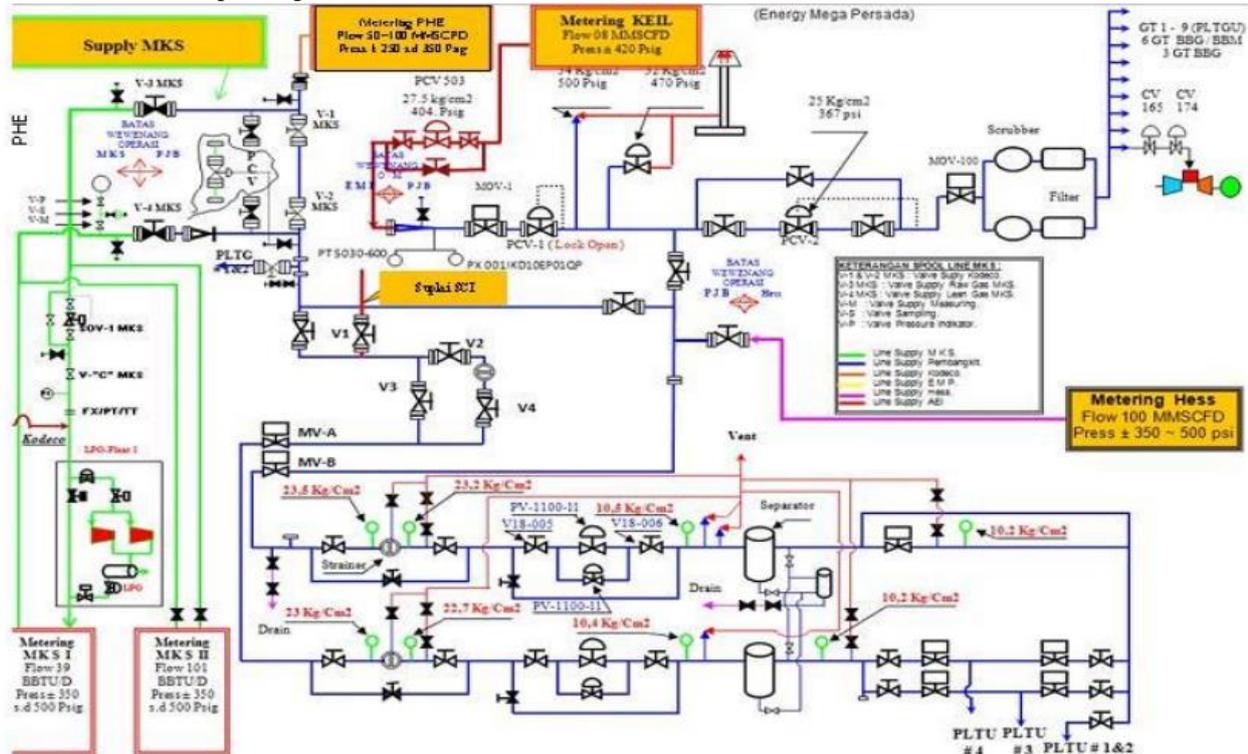


Fig. 1. Modified fuel combustion system

IV. RESULTS

Emission reduction performances due to converting fuel oil to gas can be obtain by flue gas visual observation at stack outlet and inside heat transfer equipments such as boiler, More accurate evident can be obtained by emission measurement using online instrument or laboratory testing. The flue gas condition after retrofitting using flue gas can be seen in Figure 2. The performance of combustion in the boiler can be exhibited by the cleanliness of the tube, as shown in Figure 3..

Quality of power plant flue gas using fuel gas has good performance, except SO_x ontnete that out of allowable emission contin from government. After utilizing fuel gas, all quality parameters of flue gas not exceed the maximum limit from government

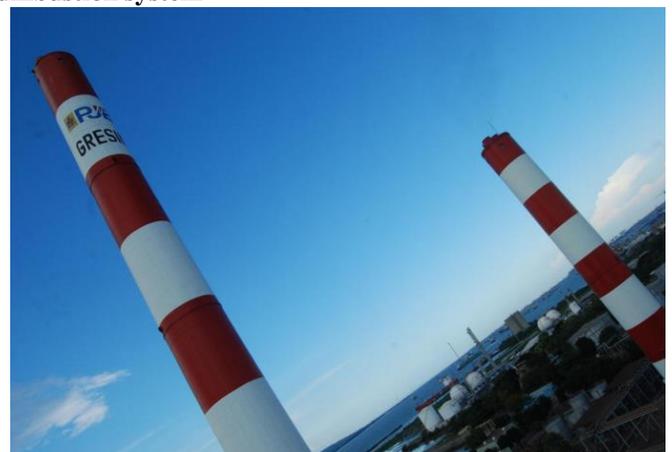


Fig. 2. Clean flue gas at stack outlet using gas



Fig. 1. Tube inside boiler before and after using gas

CO₂ emission measurement using online instrument and laboratory testing were performed to obtain

qualitative data. The data were compared with the same power plant in the world. Some power plant pollutant content in flue gas data consisted in the benchmarking NRDC 2013 [7] and PT.PJB UP GRESIK 2013 were compared and there are tabulated in Table 1.

In term of CO₂ emission, PT. PJB UP Gresik lay at the best ten compared to other power plant performance in America. It is shown PT. PJB UP Gresik have been performing best green practice especially in reducing CO₂ emission in the steam power plant by utilize fuel gas.

Table 1. Benchmarking NRDC 2013 and PT.PJB - GRESIK 2013

NO	Power Plant	Total Production (MWh)	CO ₂ Emission (Tone)	CO ₂ Emission Intensity (Tone/GWh)	CO ₂ Emission Intensity Average (Tone/GWh)
		1	2	(2/1)*1000	
1	Sacramento Municipal Util Dist	6765215	2334956	345141	451283
2	Sempre	13258115	4965089	374494	449081
3	Calpine	103040845	41996312	407570	449081
4	Exxon Mobil	11388564	4740664	416265	449081
5	Dow Chemical	13372349	5746793	429752	449081
6	Rockland Capital	13565458	5911134	435749	449081
7	Energy Investors Funds	10343553	4680042	452460	449081
8	Tenaska	16161599	7349385	454744	449081
9	Occidental	14093903	6491309	460576	449081
10	PJB UP Gresik	11422633	5391258	471980	449081
11	J-Power	8439903	4017573	476021	449081
12	Brazos Electric Power Coop	7212209	3615188	501259	449081
13	Entegra Power	10386954	5533581	532743	449081
14	NV Energy	22084046	12349673	559212	449081

V. CONCLUSION

The utilization of fuel gas by retrofitting oil fuel combustion steam power plant was performed successfully. The evidents were compared with the same power plant in the world. In term of CO₂ emission, PT. PJB UP Gresik lay at the best ten compared to other power plant performance in America. It is shown PT. PJB UP Gresik have been performing best green practice especially in reducing CO₂ emission in the steam power plant by utilize fuel gas.

ACKNOWLEDGMENT

The authors gratefully thank to PT. PJB UP Gresik, Indonesia for providing the facilities in conducting this research.

REFERENCES

1. Totok R. Biyanto, Green Concept in Engineering Practice, invited speaker at 1st International Seminar on Science and Technology 2015, 5 August 2015, ITS Surabaya, ISSN 2460-6170
2. EPA, Methodology for Estimating Emissions of CO₂ from Fossil Fuel Combustion, US Environmental Protection Agency: 2014

3. E. Dendy Sloan, Fundamental principles and applications of natural gas hydrates, Nature 426, 353-363 (20 November 2003)
4. SA Iqbal, Y Mido, Chemistry of Air & Air Pollution, Discovery Publishing, 2010
5. A. Roberts, R. Brooks, P. Shipway, "Internal combustion engine cold-start efficiency: A review of the problem, causes and potential solutions", Energy Conversion and Management, Volume 82, June 2014, Pages 327-350
6. D. Sarkar, Thermal power plant, 2015.
7. Christopher E. Van Atten, Benchmarking Air Emissions, M. J. Bradley & Associates LLC, 2013

Totok R. Biyanto, Process Design, Control and Optimization Lab Engineering Physics Dept. Industrial Technology Faculty ITS Surabaya 60111 <http://personal.its.ac.id/dataPersonal.php?userid=trb-ep>